

# MPS No. 1021

**Subject: 2012 IECC Insulation Requirements**


**Date: April 2012 (Revised January 2019)**

ThermaFoam R-Control insulation is a versatile insulation material which is suitable for installation in all areas of buildings. ThermaFoam R-Control insulation is available in a wide range of types and sizes to ensure that building owners are able to meet the most advanced energy code requirements, such as those published by the International Code Council (ICC). This bulletin provides a summary of the prescriptive insulation requirements of the 2012 edition of International Energy Conservation Code (IECC) published by ICC. Please refer to the 2012 IECC for detailed information.

The IECC is a leading energy code that is applicable to both commercial and residential buildings and is often adopted as a code requirement at the State level. State adoption of IECC may also be to the prior versions of the IECC issued in 2006 and 2009.

The tables included with this bulletin provide the minimum prescriptive insulation requirements of IECC-2012. Alternative paths for conformance through detailed analysis are also available within the standard. Insulation requirements vary according to Climate Zone.

### Climate Zones

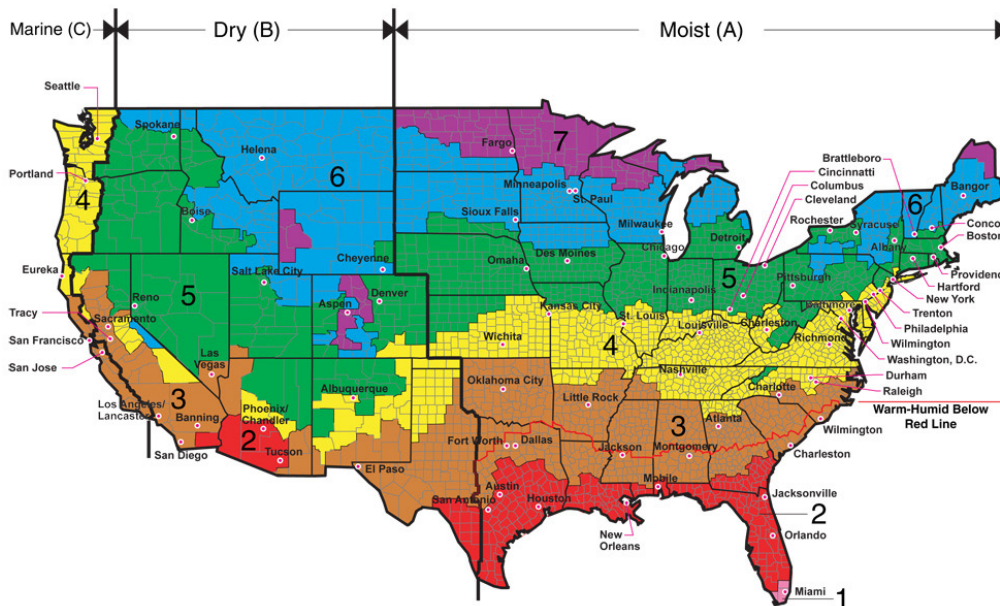

All of Alaska in Zone 7 except for the following Boroughs in Zone 8: Bethel, Dellingham, Fairbanks, N. Star, Nome North Slope, Northwest Arctic, Southeast Fairbanks, Wade Hampton, and Yukon-Koyukuk

Zone 1 includes: Hawaii, Guam, Puerto Rico, and the Virgin Islands

## Residential

The IECC provides prescriptive insulation requirements for residential buildings. The first number in the table below is the requirement for cavity insulation and the second number is for continuous insulation (ci).

IECC-2012 Prescriptive R-value Residential							
Zone	Wood-Framed <sup>1</sup> Wall	Mass <sup>2</sup> Wall	Basement Wall <sup>3</sup>	Slab <sup>4</sup> Wall	Floor	Crawl Space	Ceiling
1	R-13	R-3/4	0	0	R-13	0	R-30
2	R-13	R-4/6	0	0	R-13	0	R-38
3	R-13+5ci or R-20	R-8/13	R-5/13	0	R-19	R-5/13	R-38
4 except Marine	R-13+5ci or R-20	R-8/13	R-10/13	R-10	R-19	R-10/13	R-49
5 and 4 Marine	R-13+5ci or R-20	R-13/17	R-15/19	R-10	R-30	R-15/19	R-49
6	R-13+10ci R-20+5ci	R-15/20	R-15/19	R-10	R-30	R-15/19	R-49
7	R-13+10ci R-20+5ci	R-19/21	R-15/19	R-10	R-38	R-15/19	R-49
8	R-13+10ci R-20+5ci	R-19/21	R-15/19	R-10	R-38	R-15/19	R-49

ci = continuous insulation

1 = First value is cavity insulation, second is continuous insulation, so "13+5" means R-13 cavity insulation plus R-5 continuous insulation.

2 = The second R-value applies when more than half the insulation is on the interior of the mass wall.

3 = "15/19" means R-15 continuous insulation on the interior or exterior of the home or R-19 cavity insulation at the interior of the basement wall. "10/13" means R-10 continuous insulation on the interior or exterior of the home or R-13 cavity insulation at the interior of the basement wall.

4 = Depth of the slab insulation is 2 ft in zone 4/5 and 4 ft in zones 6/7/8.

### Commercial Walls, Above Grade

The IECC provides prescriptive insulation requirements for above grade walls of heated buildings constructed with wood framing, steel framing, metal buildings, and mass (concrete, CMU, or stone) systems. The first number in the table below is the requirement for cavity insulation and the second number is for continuous insulation (ci). Continuous insulation minimizes heat loss since the insulation is installed continuously across the wall without thermal bridges other than fasteners and service openings.

IECC-2012 Prescriptive R-value Commercial								
Walls, above grade								
	Wood-Framed		Metal-Framed		Metal-Building		Mass	
Zone	All other	Group R	All other	Group R	All other	Group R	All other	Group R
1	R-13+3.8ci or R-20	R-13+3.8ci R-20	R-13+5ci	R-13+5ci	R-13+6.5ci	R-13+6.5ci	R-5.7ci	R-5.7ci
2	R-13+3.8ci or R-20	R-13+3.8ci R-20	R-13+5ci	R-13+7.5ci	R-13+6.5ci	R-13+13ci	R-5.7ci	R-7.6ci
3	R-13+3.8ci or R-20	R-13+3.8ci R-20	R-13+7.5ci	R-13+7.5ci	R-13+6.5ci	R-13+13ci	R-7.6ci	R-9.5ci
4 except Marine	R-13+3.8ci or R-20	R-13+3.8ci R-20	R-13+7.5ci	R-13+7.5ci	R-13+13ci	R-13+13ci	R-9.5ci	R-11.4ci
5 and 4 Marine	R-13+3.8ci or R-20	R-13+7.5ci R-20+3.8ci	R-13+7.5ci	R-13+7.5ci	R-13+13ci	R-13+13ci	R-11.4ci	R-13.3ci
6	R-13+7.5ci or R-20+3.8ci	R-13+7.5ci R-20+3.8ci	R-13+7.5ci	R-13+7.5ci	R-13+13ci	R-13+13ci	R-13.3ci	R-15.2ci
7	R-13+7.5ci or R-20+3.8ci	R-13+7.5ci R-20+3.8ci	R-13+7.5ci	R-13+15.6ci	R-13+13ci	R-13+19.5ci	R-15.2ci	R-15.2ci
8	R-13+15.6ci or R-20+10ci	R-13+15.6ci R-20+10ci	R-13+7.5ci	R-13+17.5ci	R-13+13ci	R-13+19.5ci	R-25.0ci	R-25.0ci

ci = continuous insulation

### Commercial Walls, Below Grade

The IECC provides prescriptive insulation requirements for below grade walls of heated buildings. Continuous insulation minimizes heat loss since the insulation is installed continuously across the wall without thermal bridges other than fasteners and service openings.

IECC-2012 Prescriptive R-value Commercial		
Walls, below grade		
Zone	All other	Group R
1	NR	NR
2	NR	NR
3	NR	NR
4 except Marine	R-7.5ci	R-7.5ci
5 and 4 Marine	R-7.5ci	R-7.5ci
6	R-7.5ci	R-7.5ci
7	R-10.0ci	R-10.0ci
8	R-10.0ci	R-12.5ci

ci = continuous insulation

### Commercial Floors and Slabs

The IECC provides the prescriptive insulation requirements for mass floors and slab on grade floors of heated and unheated building.

IECC-2012 Prescriptive R-value Commercial						
Floors						
	Mass		Slab-On-Grade Heated		Slab-On-Grade UnHeated	
Zone	All other	Group R	All other	Group R	All other	Group R
1	NR	NR	R-7.5 for 12 in.	R-7.5 for 12 in.	NR	NR
2	R-6.3ci	R-8.3ci	R-7.5 for 12 in.	R-7.5 for 12 in.	NR	NR
3	R-10ci	R-10ci	R-10 for 24 in.	R-10 for 24 in.	NR	NR
4 except Marine	R-10ci	R-10.4ci	R-15 for 24 in.	R-15 for 24 in.	R-10 for 24 in.	R-10 for 24 in.
5 and 4 Marine	R-10ci	R-12.5ci	R-15 for 36 in.	R-15 for 36 in.	R-10 for 24 in.	R-10 for 24 in.
6	R-12.5ci	R-12.5ci	R-15 for 36 in.	R-20 for 48 in.	R-10 for 24 in.	R-15 for 24 in.
7	R-15ci	R-16.7ci	R-20 for 24 in.	R-20 for 48 in.	R-15 for 24 in.	R-15 for 24 in.
8	R-15ci	R-16.7ci	R-20 for 48 in.	R-20 for 48 in.	R-15 for 24 in.	R-20 for 24 in.


ci = continuous insulation

### Commercial Roof Insulation

The IECC provides the prescriptive insulation requirements for continuous roof insulation above roof decks.

IECC-2012 Prescriptive R-value Commercial		
Roof		
Above Deck		
Zone	All other	Group R
1	R-20ci	R-20ci
2	R-20ci	R-20ci
3	R-20ci	R-20ci
4 except Marine	R-25ci	R-25ci
5 and 4 Marine	R-25ci	R-25ci
6	R-30ci	R-30ci
7	R-35ci	R-35ci
8	R-35ci	R-35ci

ci = continuous insulation



[www.thermafoam.com](http://www.thermafoam.com)



1240 Hwy 77  
Hillsboro, TX 76645

Office: 254-582-2730  
Fax: 254-582-2811